


TRIPLEX LIFT STATION (ABOVE GROUND PIPING)
SECTION VIEW

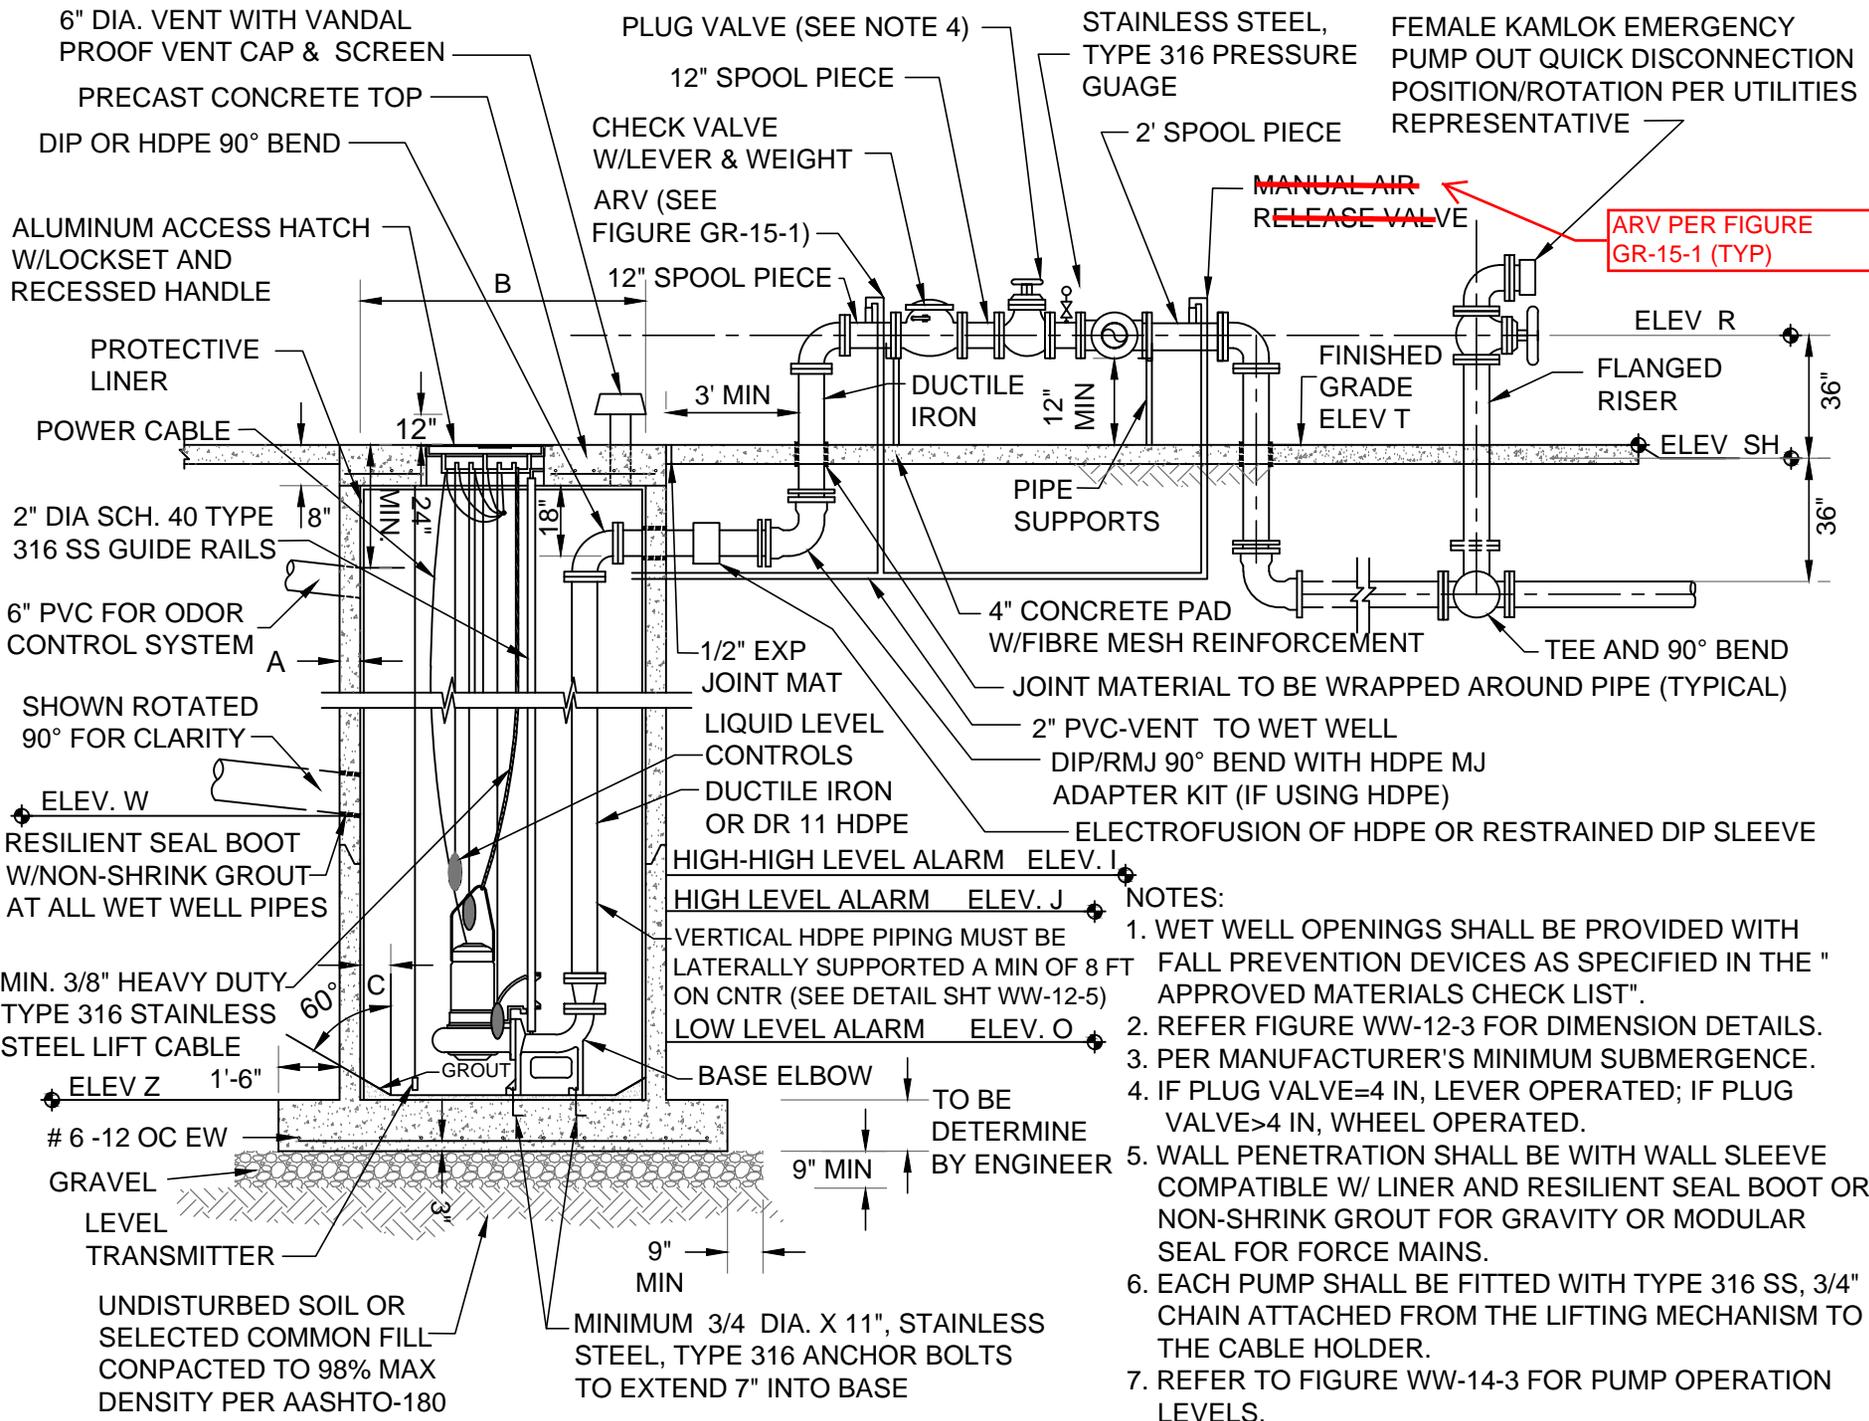

- NOTES:
1. WET WELL OPENINGS SHALL BE PROVIDED WITH FALL PREVENTION DEVICES AS SPECIFIED IN THE "APPROVED MATERIALS CHECK LIST".
 2. REFER FIGURE WW-12-3 FOR DIMENSION DETAILS.
 3. PER MANUFACTURER'S MINIMUM SUBMERGENCE.
 4. IF PLUG VALVE=4 IN, LEVER OPERATED; IF PLUG VALVE>4 IN, WHEEL OPERATED.
 5. WALL PENETRATION SHALL BE WITH WALL SLEEVE COMPATIBLE W/ LINER AND RESILIENT SEAL BOOT OR NON-SHRINK GROUT FOR GRAVITY OR MODULAR SEAL FOR FORCE MAINS.
 6. EACH PUMP SHALL BE FITTED WITH TYPE 316 SS, 3/4" CHAIN ATTACHED FROM THE LIFTING MECHANISM TO THE CABLE HOLDER.
 7. REFER TO FIGURE WW-14-3 FOR PUMP OPERATION LEVELS.

FIGURE
WW-14-2